

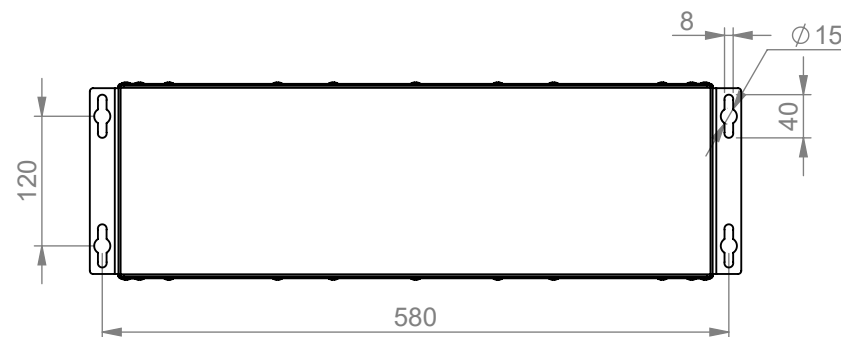
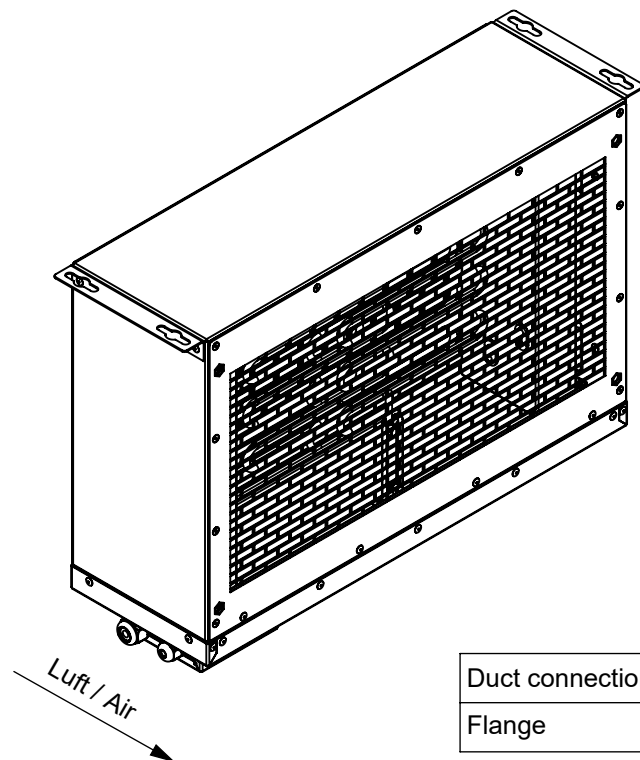


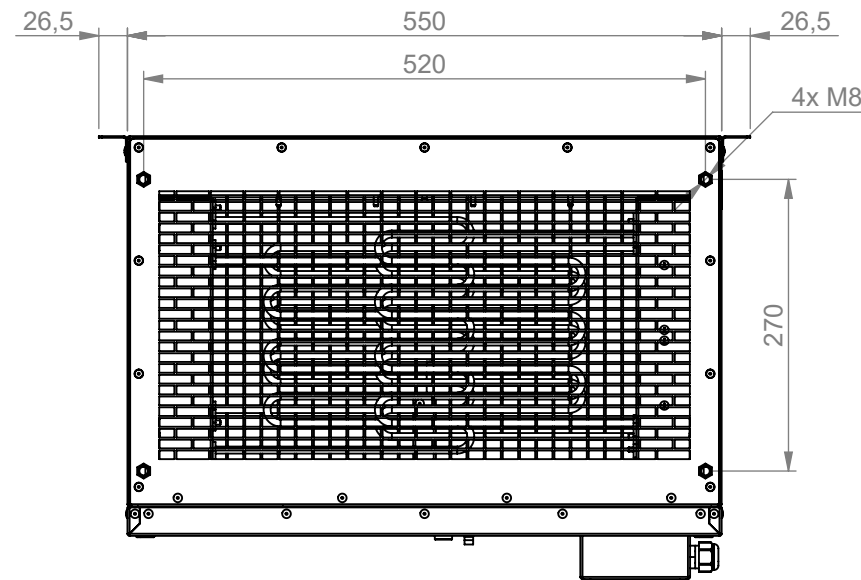

|                 |           |
|-----------------|-----------|
| Duct connection | 500 x 250 |
| Flange          | P20       |

**ruck**

ruck Ventilatoren  
Max-Planck-Str. 5  
D-97944 Boxberg

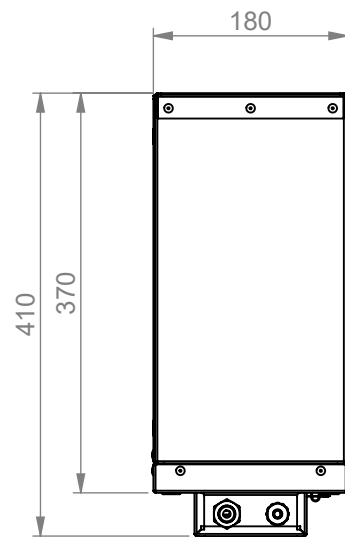

Protection Mark  
according to ISO 16016

Created d.ursu  
Drawn d.ursu  
Released a.ganea  
Disabled

1:7 A4 mm

General tolerances  
DIN ISO 2768-c

01.07.2025  
01.07.2025  
18.08.2025

**EHM05025B06**

**176168 00**